

5"x3"x3/16" GALV. STRUC. TUBING OR RECTANGULAR ABS WITH EQUIVALENT CROSS-SECTIONAL AREA

2%

CITY SIDEWALK

#3 REBAR

STRUCT. TUBING OR
ABS TO BE CUT TO
FIT CURB ANGLE.
COAT ENDS OF TUBING
WITH MIN. 2 COATS
SHERWIN WILLIAMS
"GALVITE" OR EQUAL.

THREE 5"x3"x3/16" GALV. STRUC. TUBING
OR RECTANGULAR ABS WITH EQUIVALENT
CROSS-SECTIONAL AREA


2"

12"

1 1/2"

SECTION B-B

NOTE: DRAIN ASSEMBLY SHALL
BE FABRICATED AND HOT
DIP GALVANIZED.

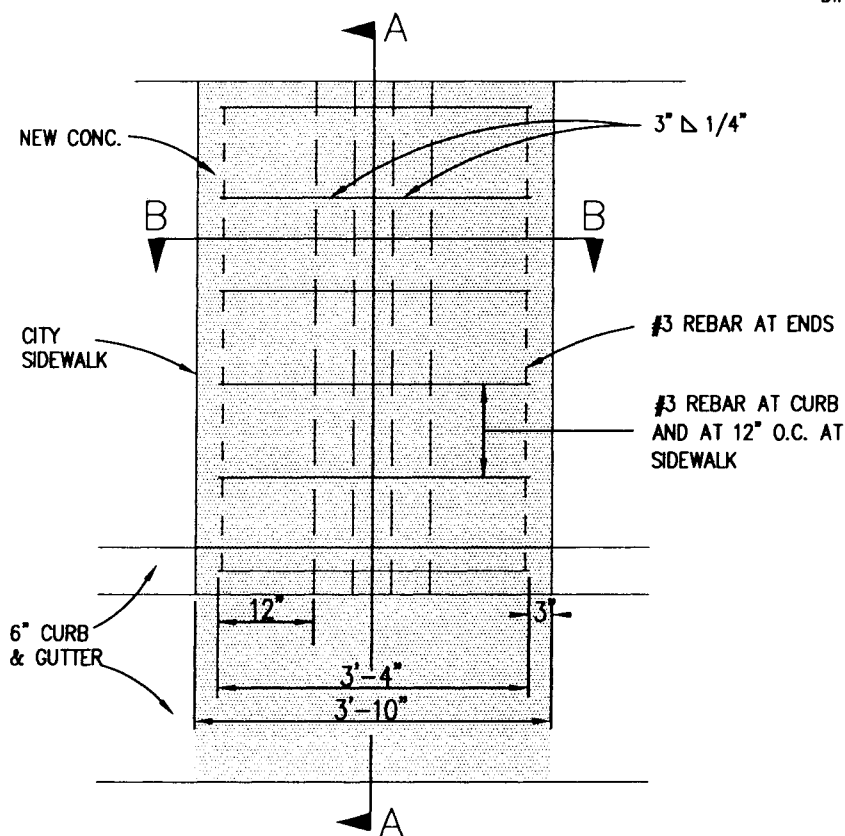

PLAN VIEW

UNDER SIDEWALK DRAIN

DATE	REVISIONS	BY

STANDARD DETAIL

DR9

APPROVED 7/21/09
DATE