


- NOTES:**
1. SERVICES SHALL HAVE SAME BEDDING AND BACKFILL AS MAIN SEWER. (SEE STANDARD DETAIL TR1)
 2. ANY REPAIRS DONE TO SERVICES OR MAINS SHALL HAVE COMPRESSION COUPLINGS WITH STAINLESS STEEL SHEAR RINGS.
 3. PIPE FOR MAIN AND SERVICES SHALL BE FUSION BONDED EPOXY LINED DUCTILE IRON PIPE, PROTECTO 401, OR CITY APPROVED EQUAL WHEN COVER IS LESS THAN 3 FEET.
 4. SERVICES SHALL BE CLAY, PROTECTO 401, OR CITY APPROVED EQUAL.
 5. SDR 17 IS ALLOWED ONLY ON EXISTING SERVICES. CONNECT WITH CLAY COLLAR AND GROUT COLLAR TO PIPE.

TAPPING SADDLE (SHOWN CONNECTED TO PIPE W/STAINLESS STEEL STRAP) SEALTITE, TwisTee BY MISSION RUBBER, Tap-N-Tee BY JOINTS, OR CITY APPROVED EQUAL.

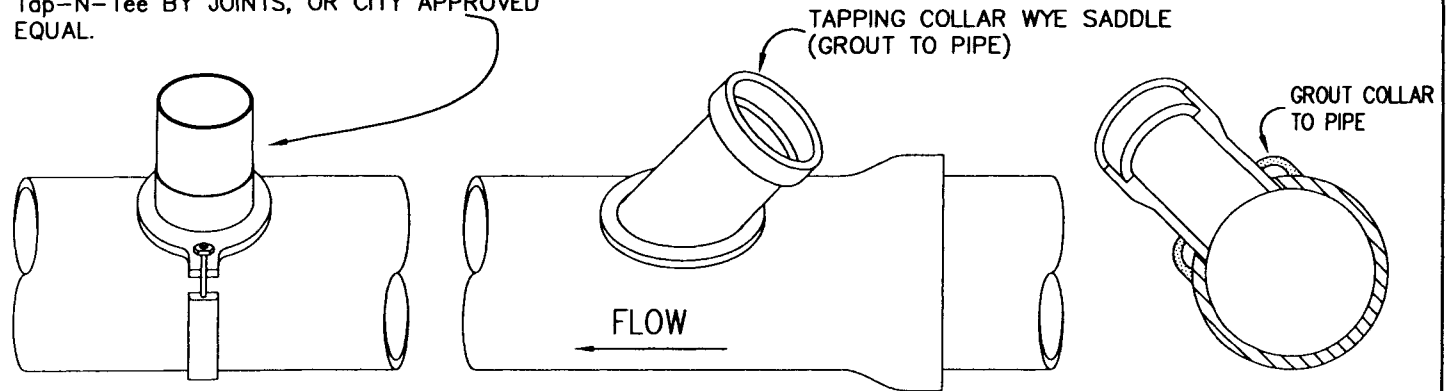

SANITARY SEWER SERVICE & CONNECTION

DATE	REVISIONS	BY

CITY OF YUBA CITY	
STANDARD DETAIL	
SS3	
APPROVED	7/21/09 DATE