


WIDTH OF SIDEWALK		
ARTERIAL	COLLECTOR	RESIDENTIAL
6'	5'	4'

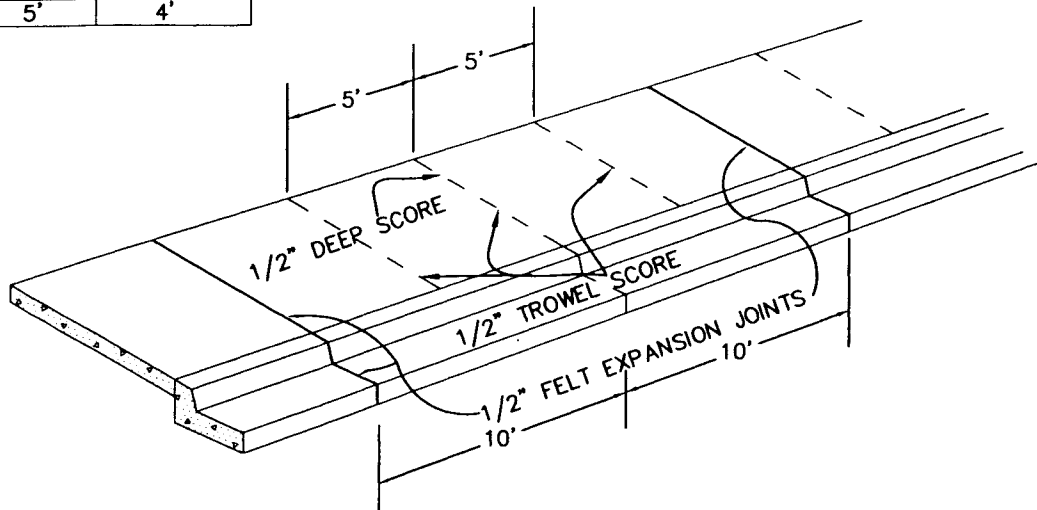

**NOTES:**

1. PROVIDE 1/2" DEEP SCORE AT 5' INTERVALS IN SIDEWALK.
2. 1/2" TRANSVERSE EXPANSION JOINTS AT 20' INTERVAL FOR SIDEWALK.
3. 1/2" TRANSVERSE EXPANSION JOINTS AT 20' INTERVAL FOR CURB & GUTTER.
4. CURB & GUTTER TO HAVE 1/2" DEEP SCORE @ 10' INTERVALS.
5. EXPANSION JOINTS IN SIDEWALK TO BE ADJACENT TO EXPANSION JOINTS IN CURB & GUTTER.
6. ALL EXPANSION JOINTS SHALL EXTEND COMPLETELY THROUGH CONCRETE.
7. CONCRETE TO MEET MIN 2500 PSI WITH MAX SLUMP OF 4" OR MEET CALTRANS REQUIREMENTS IN THE STANDARD SPECIFICATIONS SECTIONS 73 & 90.
8. SIDEWALK TO HAVE A TRANSVERSED BROOMED SURFACE TEXTURE.
9. SIDEWALK SHALL BE POURED SEPARATELY FROM CURB UNLESS OTHERWISE APPROVED BY THE CITY ENGINEER.

**ATTACHED  
SIDEWALKS  
CURB & GUTTER**

DATE	REVISIONS	BY

CITY OF YUBA CITY	
STANDARD DETAIL	
ST8	
<i>G. M. H.</i>	7/21/09
APPROVED	DATE