



COVER DETAIL

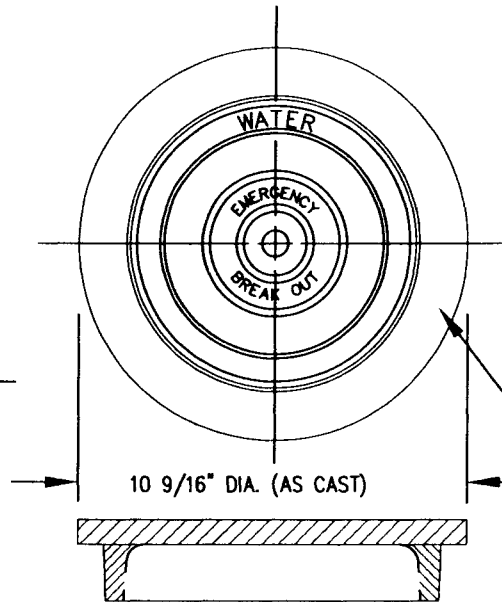

D AND L SUPPLY K-6016 TRAFFIC RATED MONUMENT RING AND COVER OR APPROVED EQUAL MARKED "WATER"

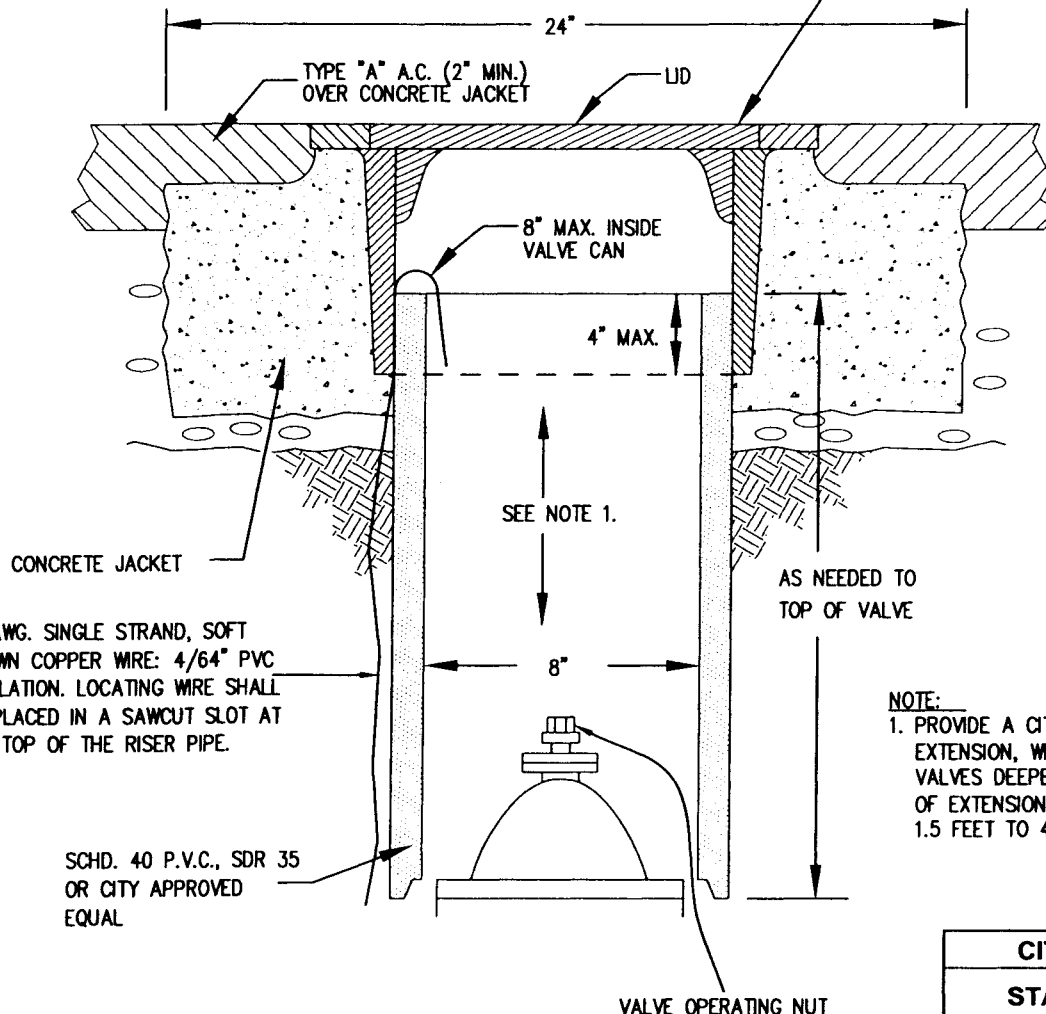

NOTE:
1. PROVIDE A CITY APPROVED VALVE EXTENSION, WITH A RISER CAN, FOR VALVES DEEPER THAN 6.0 FEET. HEIGHT OF EXTENSION SHALL TERMINATE AT 1.5 FEET TO 4.0 FEET BELOW GRADE.

WATER VALVE BOX

CITY OF YUBA CITY	
STANDARD DETAIL	
W4	
<i>[Signature]</i>	7/21/09
APPROVED	DATE

DATE	REVISIONS	BY