


**NOTES:**

1. SERVICES SHALL BE COPPER TYPE "K" SOFT.
2. SPLICES IN THE SERVICE LINE ARE TO BE AVOIDED; BUT WHERE APPROVED, THEY SHALL BE MADE USING CTS GRIP-TYPE COMPRESSION COUPLINGS.
3. ALL FITTINGS ARE COPPER OR BRASS AND SHALL BE MUELLER 110 (CONDUCTIVE TYPE) COMPRESSION CONNECTIONS OR CITY APPROVED EQUAL.
4. WHEN BACKFLOW PREVENTER IS REQUIRED, SEE DETAIL W10.
5. ROCK BOTTOM OF BOX WITH 3" MIN. OF 3/4" MINUS CRUSHED ROCK.
6. PACK JOINT FITTINGS ARE NOT ACCEPTABLE.
7. ALL MATERIALS SHALL COMPLY WITH ASSEMBLY BILL 1953 (LEAD FREE LAW).
8. NO ABOVE GROUND STRUCTURES SHALL BE PLACED WITHIN 3 FEET OF THE WATER METER.

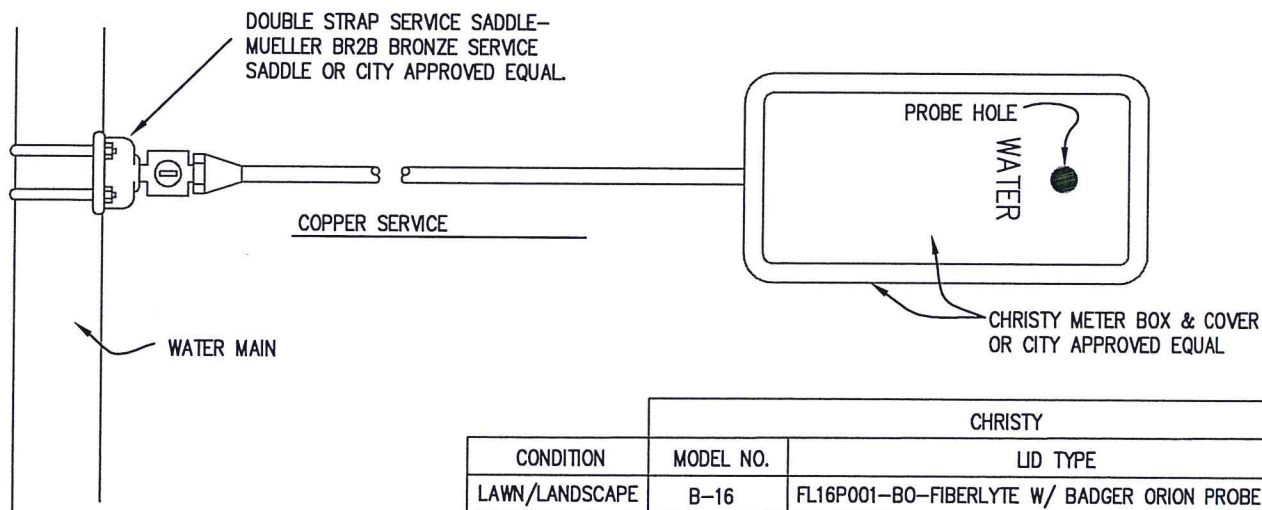

CHRISTY		
CONDITION	MODEL NO.	LID TYPE
LAWN/LANDSCAPE	B-16	FL16P001-B0-FIBERLYTE W/ BADGER ORION PROBE HOLE
CONCRETE	APPROVED ON A CASE-BY CASE BASIS	

# 1" WATER SERVICE MAIN CONNECTION

11/8/10	changed meter to radio read	sal
11/17/11	lead free law	sal
4/21/16	changed meter to cellular read; added note 7	sal
DATE	REVISIONS	BY

CITY OF YUBA CITY	
STANDARD DETAIL	
W6	
<i>Diana Landley</i> APPROVED	4/22/16 DATE