


CORPORATION STOP—
MUELLER 300 BALL VALVE
OR CITY APPROVED EQUAL.

NOTES:

1. 1 1/2" & 2" SERVICES SHALL BE COPPER TYPE "K" HARD UNLESS OTHERWISE NOTED.
2. ALL FITTINGS ARE COPPER OR BRASS AND SHALL BE MUELLER 110 (CONDUCTIVE TYPE) COMPRESSION CONNECTIONS OR CITY APPROVED EQUAL.
3. INSTALLATION SHOWN IS FOR USE WITH A NON-TURBO TYPE METER. FOR TURBO TYPE METER, SEE DETAIL W10.
4. WHEN BACKFLOW PREVENTER IS REQUIRED, SEE DETAIL W10.
5. ROCK BOTTOM OF BOX WITH 3" MIN. OF 3/4" MINUS CRUSHED ROCK.
6. PACK JOINT FITTINGS ARE NOT ACCEPTABLE.
7. ALL MATERIALS SHALL COMPLY WITH ASSEMBLY BILL 1953 (LEAD FREE LAW).
8. NO ABOVE GROUND STRUCTURES SHALL BE PLACED WITHIN 3 FEET OF THE WATER METER.

DOUBLE STRAP SERVICE SADDLE—
MUELLER BR2B BRONZE SADDLE
OR CITY APPROVED EQUAL.

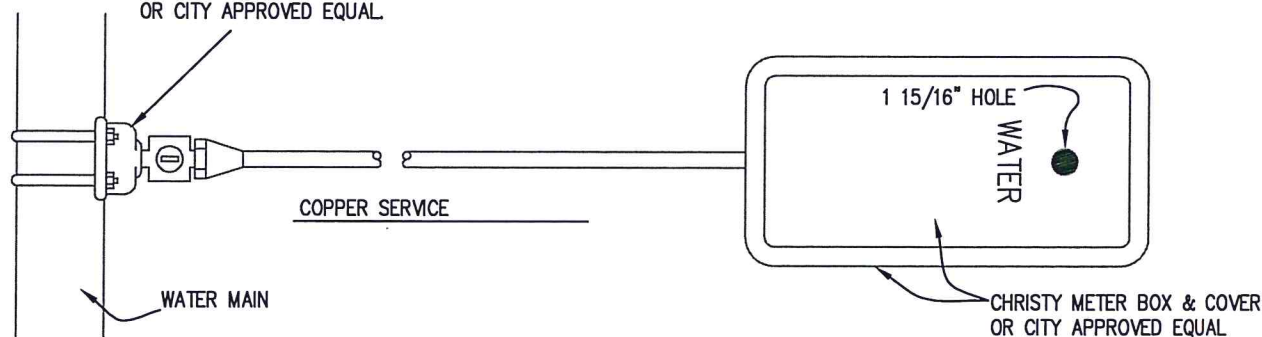

CHRISTY		
METER SIZE	MODEL NO.	LID TYPE
1 1/2"	B-36	FIBERLITE-36 w/PROBE HOLE
2"	B-36	FIBERLITE-36 w/PROBE HOLE

1 1/2" & 2" WATER SERVICE MAIN CONNECTION

11/17/11	changed meter to radio read	sal
11/17/11	lead free law	sal
4/21/16	changed meter to cellular read; added note 8.	sal
DATE	REVISIONS	BY

CITY OF YUBA CITY	
STANDARD DETAIL	
W7	
<i>Diana Langley</i> APPROVED	4/22/16 DATE