
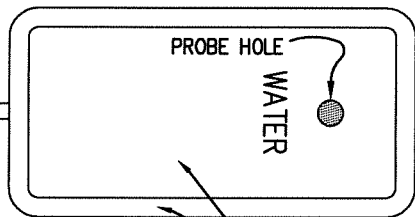


CORPORATION STOP—
MUELLER 300 BALL VALVE OR
CITY APPROVED EQUAL

NOTES:

1. 1" SERVICES SHALL BE COPPER TYPE "K" SOFT.
2. SPLICES IN THE SERVICE LINE ARE TO BE AVOIDED; BUT WHERE APPROVED, THEY SHALL BE MADE USING CTS GRIP-TYPE COMPRESSION COUPLINGS.
3. ALL FITTINGS ARE COPPER OR BRASS AND SHALL BE MUELLER 110 (CONDUCTIVE TYPE) COMPRESSION CONNECTIONS OR CITY APPROVED EQUAL.
4. WHEN BACKFLOW PREVENTER IS REQUIRED, SEE DETAIL W10.
5. ROCK BOTTOM OF BOX WITH 3" MIN. OF 3/4" MINUS CRUSHED ROCK.
6. PACK JOINT FITTINGS ARE NOT ACCEPTABLE.

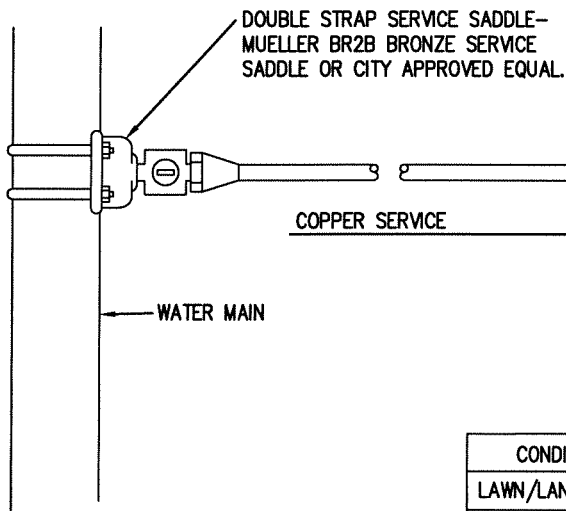

CHRISTY METER BOX & COVER
OR CITY APPROVED EQUAL

CHRISTY		
CONDITION	MODEL NO.	LID TYPE
LAWN/LANDSCAPE	B-16	FL16P001-B0-FIBERLYTE W/ BADGER ORION PROBE HOLE
CONCRETE	APPROVED ON A CASE-BY CASE BASIS	

1" WATER SERVICE MAIN CONNECTION

DATE	REVISIONS	BY
11/8/10	changed meter to radio read	sal

CITY OF YUBA CITY	
STANDARD DETAIL	
W6	
<i>[Signature]</i>	12/3/10
APPROVED	DATE