


NOTES:

1. 1 1/2" & 2" SERVICES SHALL BE COPPER TYPE "K" HARD UNLESS OTHERWISE SPECIFIED.
2. ALL FITTINGS ARE COPPER OR BRASS AND SHALL BE MUELLER 110 (CONDUCTIVE TYPE) COMPRESSION CONNECTIONS OR CITY APPROVED EQUAL.
3. INSTALLATION SHOWN IS FOR USE WITH A NON-TURBO TYPE METER. FOR TURBO TYPE METER, SEE DETAIL W10.
4. WHEN BACKFLOW PREVENTER IS REQUIRED, SEE DETAIL W10.
5. ROCK BOTTOM OF BOX WITH 3" MIN. OF 3/4" MINUS CRUSHED ROCK.
6. PACK JOINT FITTINGS ARE NOT ACCEPTABLE.

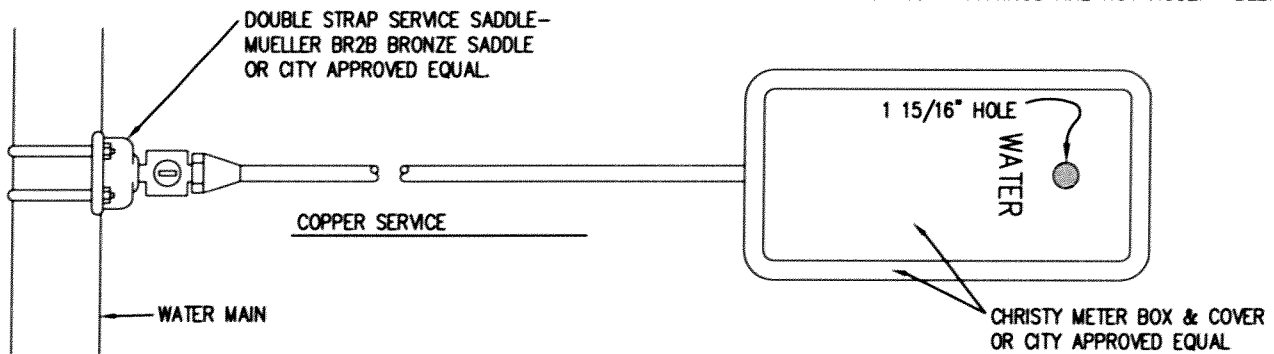

CHRISTY		
METER SIZE	MODEL NO.	LID TYPE
1 1/2"	B-36	FIBERLITE-36 w/PROBE HOLE
2"	B-36	FIBERLITE-36 w/PROBE HOLE

1 1/2" & 2" WATER SERVICE MAIN CONNECTION

DATE	REVISIONS	BY

CITY OF YUBA CITY	
STANDARD DETAIL	
W7	
APPROVED	DATE
<i>[Signature]</i>	3-3-10